

SEELEVEL II™



709-P3W Wiring Diagram

Pigtail A Wires

Pin	Color	Function
1	-	-
2	White	Pump LED
3	-	-
4	Red	+12V
5	Black	Ground
6	Blue	Tank Senders
7	Green	LPG Tank

Pigtail B Wires

Pin	Color	Function
1	Yellow	3-way Term 1
2	Purple	3-way Common
3	Orange	3-way Term 2
4	-	-
5	-	-
6	-	-

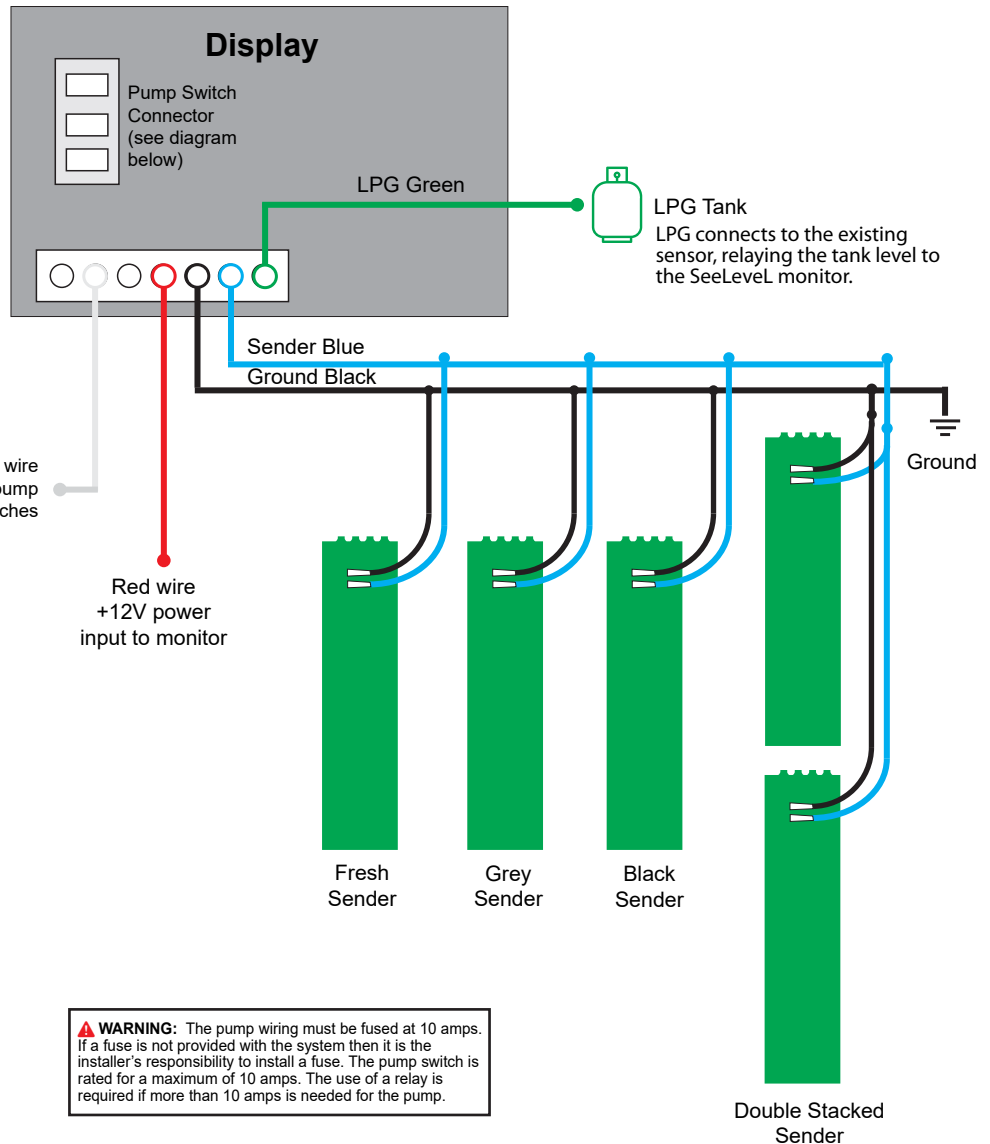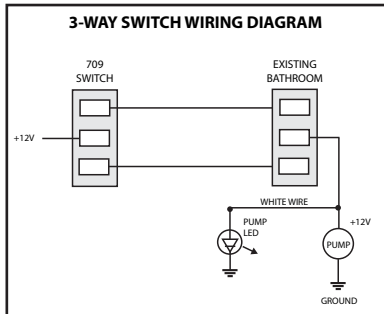

WARNING: The pump wiring must be fused at 10 amps. If a fuse is not provided with the system then it is the installer's responsibility to install a fuse. The pump switch is rated for a maximum of 10 amps. The use of a relay is required if more than 10 amps is needed for the pump.